


EM=770

LCMS Scan ESI+

Ret. Time: 0.56 <<<< POSITIVE SPECTRA >>>>


F

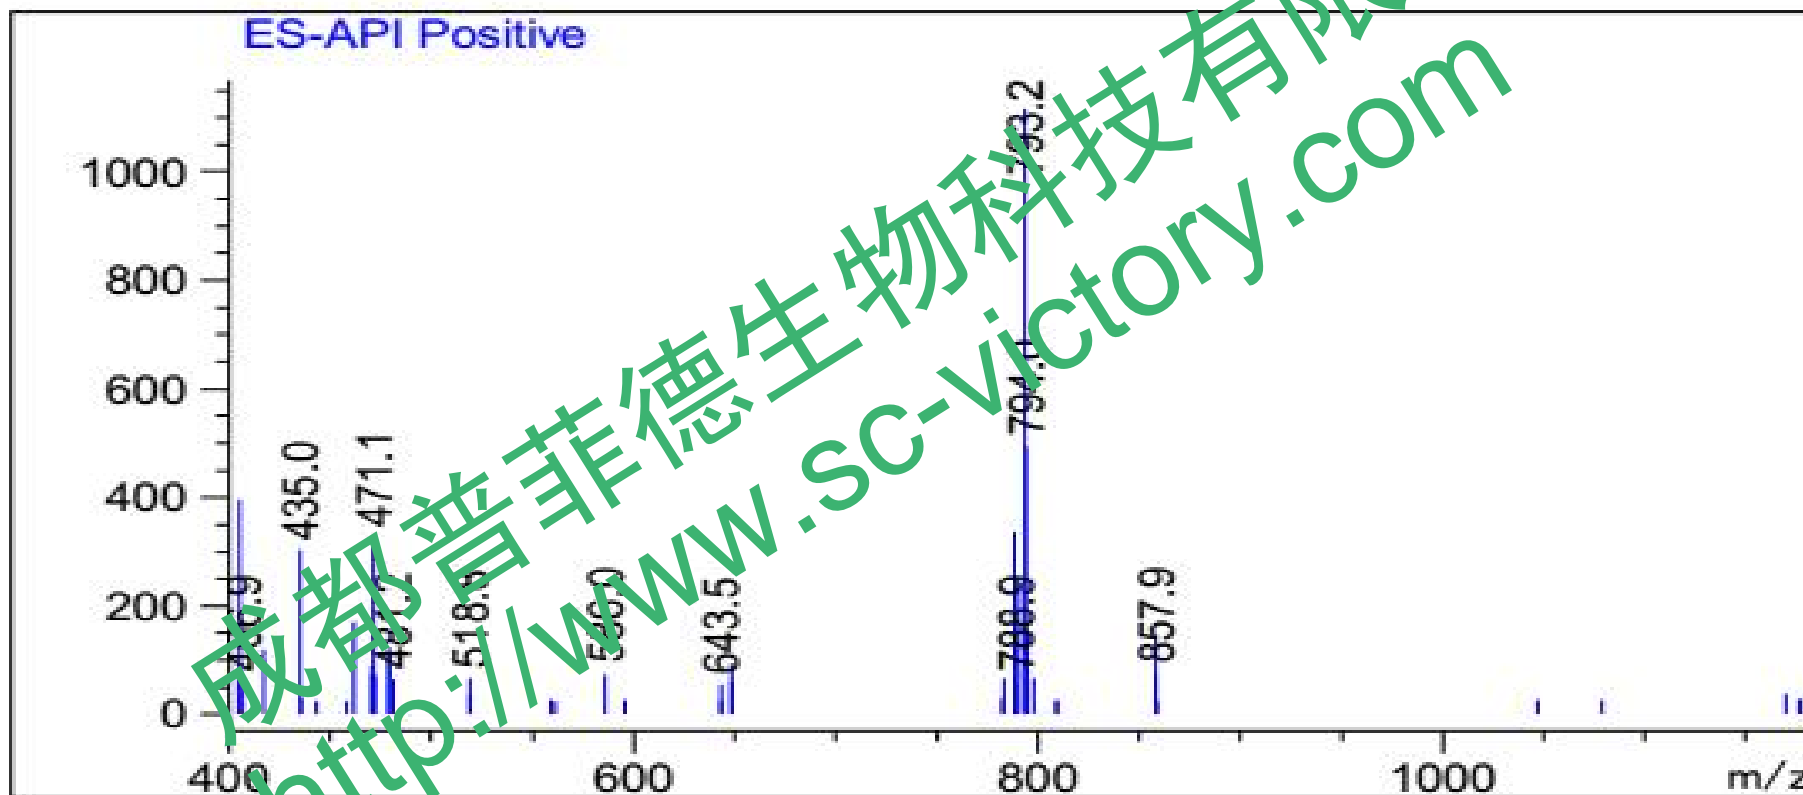

EM=770

LCMS Scan ESI-

Ret. Time: 0.57 <<<< NEGATIVE SPECTRA >>>>

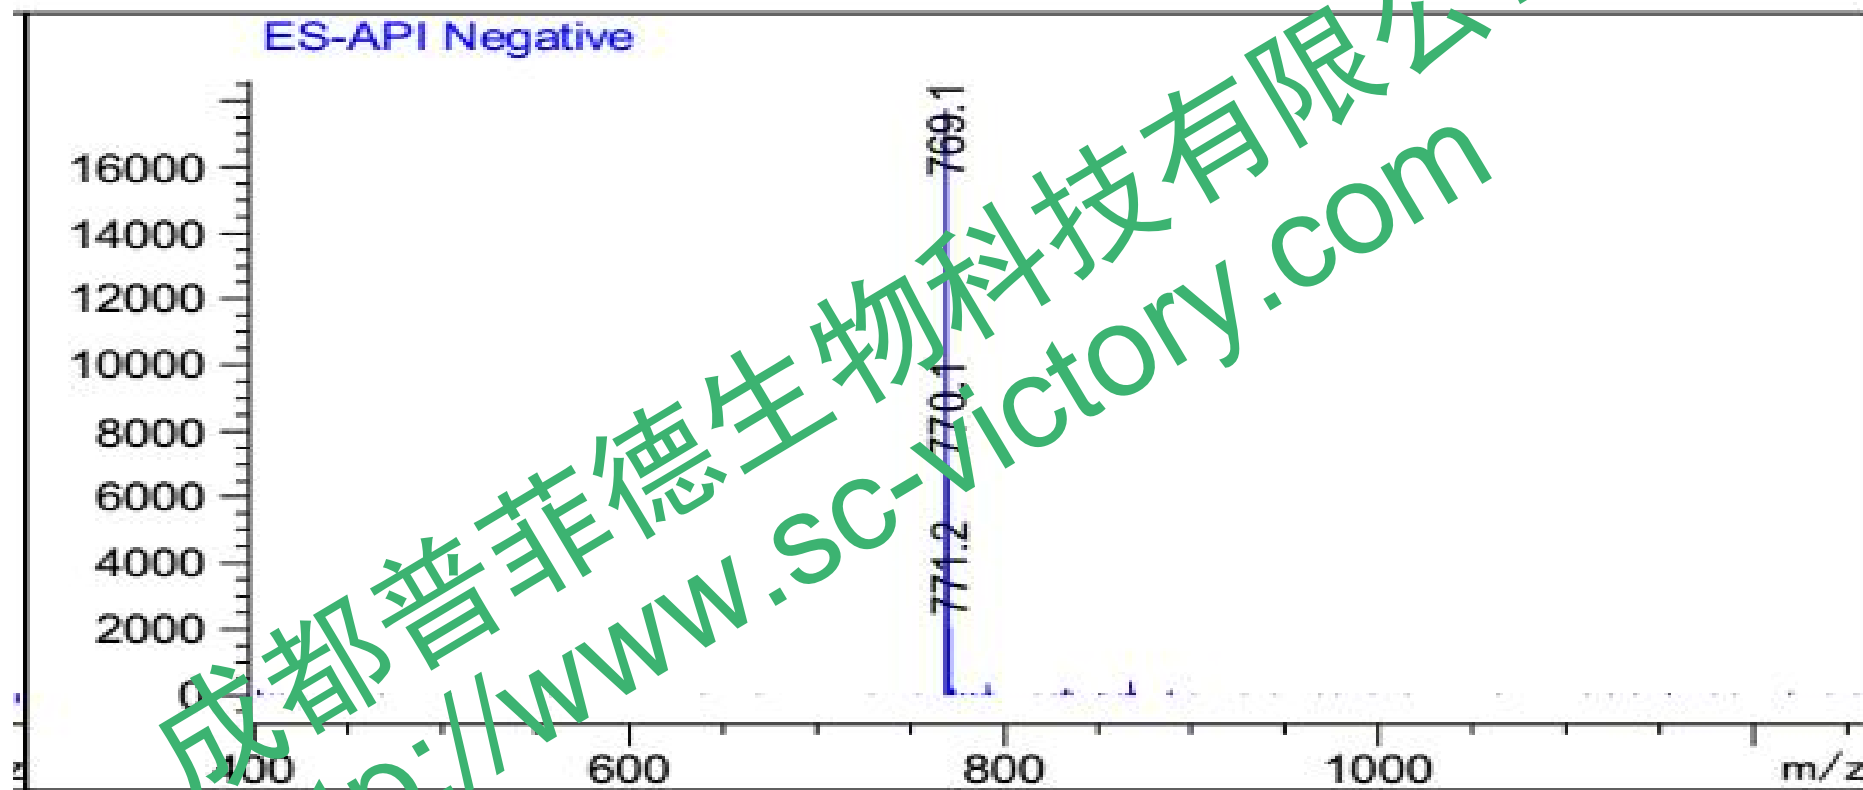

成都普菲德生物科技有限公司  
<http://www.sc-victory.com>